



Notified Body number: 2018

TEST REPORT No. **112 SF/19 IS en**

page (pages)

**Date: 12 of August 2019**

1 (8)

### BURGLAR RESISTANCE

(test name)

Test methods: LST EN 1628:2011+A1:2016 Pedestrian doorsets, windows, curtain walling, grilles and shutters – Burglar resistance - Test method for the determination of resistance under static loading.  
LST EN 1629:2011+A1:2016 Pedestrian doorsets, windows, curtain walling, grilles and shutters – Burglar resistance – Test method for the determination of resistance under dynamic loading.  
LST EN 1630:2011+A1:2016 Pedestrian doorsets, windows, curtain walling, grilles and shutters - Burglar resistance - test method for the determination of resistance to manual burglary attempts

(number of normative document or test method, description of test procedure, test uncertainty)

Specimen description: Doors Gerlock Classic. Dimensions: Height - 2040mm, width - 1000mm. Material of the frame profile: metal. System: one-handed doors. Opening: rightward inside, rightward outside. Fittings: 1150R/3739. Fixations and places (units) of fixation: 2. Gaskets: the "P" and „E“shaped. Glazing: none. Other details: none.

(identification of the specimen)

Customer: UAB „Munitus“, Žarijų g. 4, LT-02300 Vilnius  
(name and address of enterprise)

Manufacturer: UAB „Munitus“, Žarijų g. 4, LT-02300 Vilnius  
(name and address of enterprise)

#### Test results according to LST EN 1627:2011

| Name of the indicator and unit                    | Test standard reference no. | Test result     |
|---|-----------------------------|-----------------|
| The resistance under static loading, class        | LST EN 1628:2011+A1:2016    | <b>RC3- YES</b> |
| The resistance under dynamic loading, class       | LST EN 1629:2011+A1:2016    | <b>RC3- YES</b> |
| The resistance to manual burglary attempts, class | LST EN 1630:2011+A1:2016    | <b>RC3- YES</b> |

Note. The testing are carried out in purpose for conformity assessment of the product according to LST EN 14351-1:2006+A2:2016

Specimen delivery date: 2019-08-05 Test date: 2019-08-06

Sampling: The test specimen sampled by customer. Order description N° 112/19, 2019-08-06

Additions information: Application, 2019-05-21, drawing.  
(any deviations, complementary tests, exceptions and any information related with particular test)


Annex: 1 - Cross section of the specimen; 2-Test photo  
(the numbers of the annexes should be pointed out)

Technical manager: J. Ramanauskas  
(approves the test results) (n., surname)

Tested by: V. Paukštys  
(technically responsible for testing) (n., surname)

(signature)

(signature)

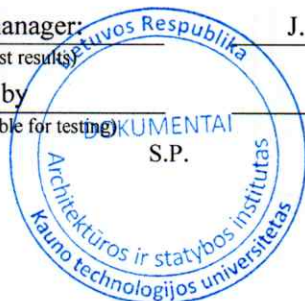

Validity – the named data and results refer exclusively to the tested and described specimens.  
Notes on publication – no part of this document may be photocopied, reproduced or translated to another language without the prior written consent of the Laboratory of Building Physics.